


DO NOT SCALE.

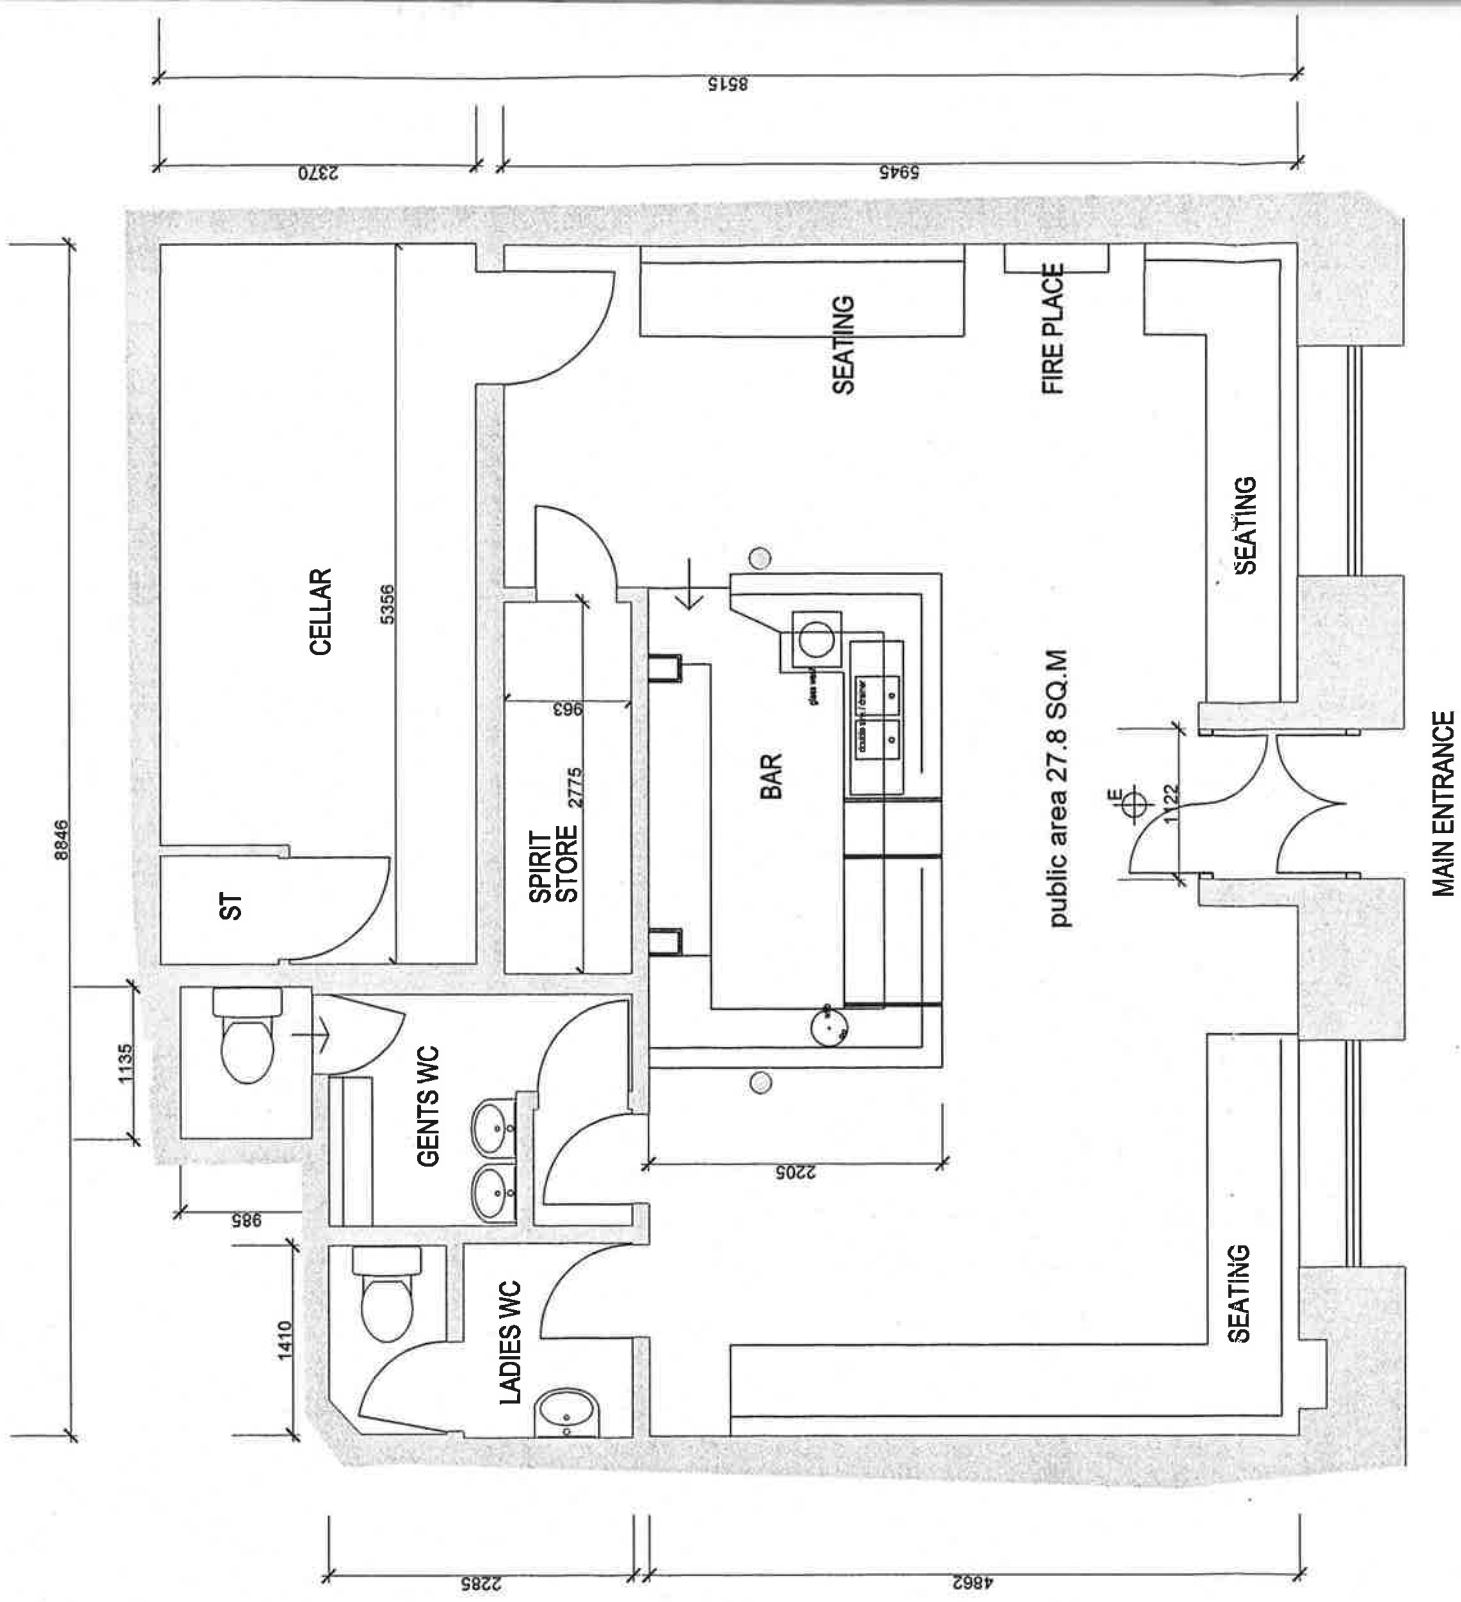

- ☒ BREAK GLASS UNIT
- ☒ ALARM SOUNDER
- Ⓢ SMOKE DETECTOR
- Ⓢ CEILING MOUNTED EMERGENCY LIGHTING
- ☒ E WALL MOUNTED EMERGENCY LIGHTING
- ☒ Co2 FIRE EXTINGUISHER
- Ⓢ W FIRE EXTINGUISHER
- Ⓢ P FIRE EXTINGUISHER
- Ⓢ F FIRE EXTINGUISHER
- Ⓢ C FIRE EXTINGUISHER
- Ⓢ (FB) FIRE BLANKET

EXISTING BAR PUBLIC AREA
@ 0.5 PERSONS PER SQ.M

=
=

27.8 SQ.M
56 PERSONS